


Figure 4: Mean Contaminant Concentrations in Water Samples from Stormwater Ponds in Guelph and the GTA (1997)

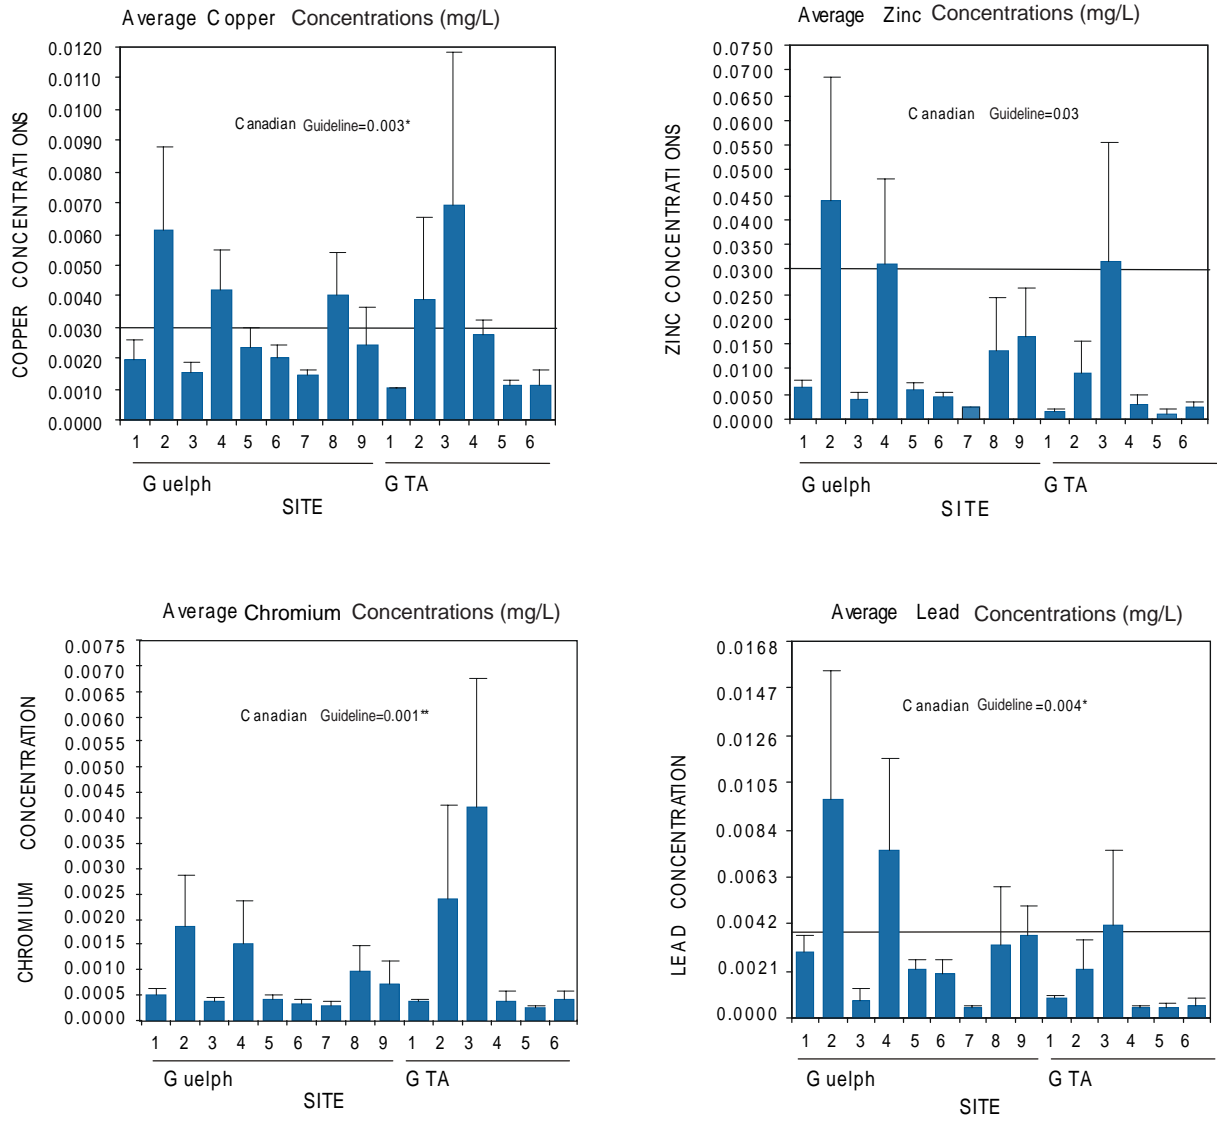

*Assuming water hardness of 120-180 mg/L CaCO₃

**Guideline based on hexavalent chromium which constitutes 10-60 % of unfiltered samples