


Water System Sizing Worksheet



Water System Sizing Worksheet

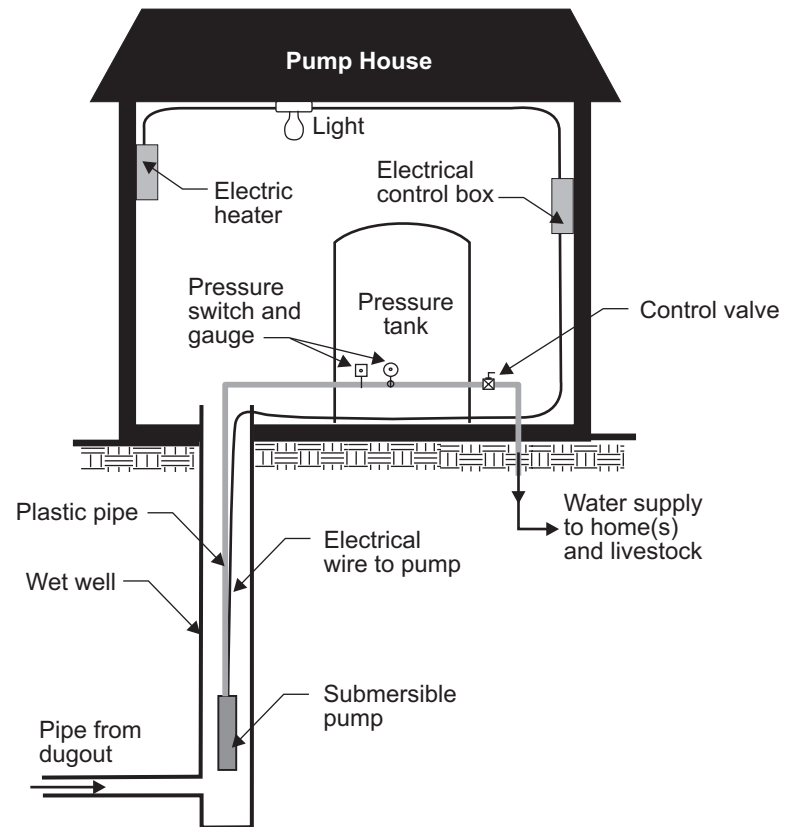

This worksheet can be used to determine the size of pump, pressure tank, and water pipe required for a farm water system. Dugouts, unlike most water wells, have a huge reservoir of water, and can be pumped at much higher flow rates. Therefore, it is important to properly size dugout pumps and pipelines to take full advantage of the dugout.

Enter all information calculated step by step in the recording section below as follows:

- Step 1 Water System Fixtures**
- Step 2 Required Pump Flow Rate** _____ gallons per minute
- Step 3 Conversion to U.S. Gallons** _____ U.S. gallons per minute
- Step 4 Pump Selection**
 - Lift _____ feet
 - Pressure needed _____ psi
 - Pump horsepower required _____ hp other specifications _____
- Step 5 Pressure Tank Size** _____ U.S. gallons other specifications _____
- Step 6 Length of Supply Pipeline** _____ feet
- Step 7 Pipe Size** _____ inches other specifications _____

STEPS TO SIZING YOUR WATER SYSTEM

Step 1 Calculate the peak water use rates in gallons per minute (gpm) for all of the existing and proposed water system fixtures.

Water System Fixtures	No. of Fixtures	Peak Use Rate	Totals
Automatic Cattle Waterers (100 head size)	_____ x	5 gpm =	_____ gpm
Hog Nipple Waterers	_____ x	1 gpm =	_____ gpm
Poultry Fountain	_____ x	1 gpm =	_____ gpm
Yard Hydrants	_____ x	5 gpm =	_____ gpm
Household (number of households)	_____ x	5-10 gpm =	_____ gpm
Fire Hydrant	_____ x	10 gpm =	_____ gpm
Other _____	_____ x	_____ gpm =	_____ gpm
Other _____	_____ x	_____ gpm =	_____ gpm

Step 2 To determine the Required Pump Flow Rate you need to consider which water uses listed in **Step 1**, will likely occur at the same time and total those together. **Note:** The minimum design flow rate of the system must exceed the peak use rate of the fixture(s) that use the largest amount of water.

Required Pump Flow Rate = _____ gpm

Step 3 Convert the Required Pump Flow Rate from **Step 2** into U.S. gallons because practically all pumps available in Canada are rated in U.S. gpm.

Conversion to U.S. Gallons
 Required Pump Flow rate _____ gpm x 1.2 = _____ U.S. gpm

Step 4 To select a pump you need to determine the lift and pressure. It is recommended that you take this information plus the Converted Pump Flow Rate from **Step 3**, to a reputable pump dealer or a water specialist for correct pump selection. They will recommend the required pump horsepower and other specifications.

Pump Selection
 Lift _____ Depth of dugout _____ feet + Farmyard elevation above dugout _____ feet = _____ lift in feet
 Pressure needed _____ psi
 Pump horsepower required _____ HP

Step 5 Sizing a pressure tank is based on the Converted Pump Flow Rate and the amount of useable water volume or drawdown. The drawdown is the amount of water that can be withdrawn from the pressure tank between high and low pressure settings. For dugouts, the sealed diaphragm or bladder type tanks are the best choice. In these types of tanks only 1/3 of the volume of the tank is available as drawdown. Therefore, the Pressure Tank Size must be 3 times the drawdown and match the gpm rating (flow rate) of the pump. For example a 10 gpm pump requires 10 gallons of drawdown or a 30 gallon tank size.

Pressure Tank Size = 3 x Pressure tank drawdown _____ U.S. gallons = _____ U.S. gallon capacity or larger

Step 6 Measure the distance from the dugout to the center of the distributing system.

Length of Supply Pipeline = _____ feet

Step 7 To determine the Required Pipe Size match the pump flow rate from **Step 3**, in the left column of the adjacent table with the length of the supply line from **Step 6**.

Required Pipe Size = _____ inches

Note: The minimum pipe size recommended for farmyard water distribution systems is 1¼ inches. This will reduce friction losses in the pipe and allow for future expansion that was unforeseen.

Pipe Diameter (inches)

Flow Rate (U.S. gpm)	Length of Pipe				
	200 ft	400 ft	600 ft	800 ft	1000 ft
2	1	1	1	1	1
4	1	1	1	1	1
6	1	1	1¼	1¼	1¼
8	1	1¼	1¼	1¼	1¼
10	1¼	1¼	1¼	1½	1½
12	1¼	1¼	1½	1½	1½
14	1¼	1½	1½	1½	2
16	1½	1½	1½	2	2
18	1½	1½	2	2	2
20	1½	1½	2	2	2
25	1½	2	2	2	2
30	2	2	2	2	2½
35	2	2	2½	2½	2½
40	2	2½	2½	2½	2½

Note: In sizing the above lines, no allowance has been made for elevation differences. For more specific information contact a water specialist in your area.